



PIERRE CULDE-SAC PRE



DRAFT

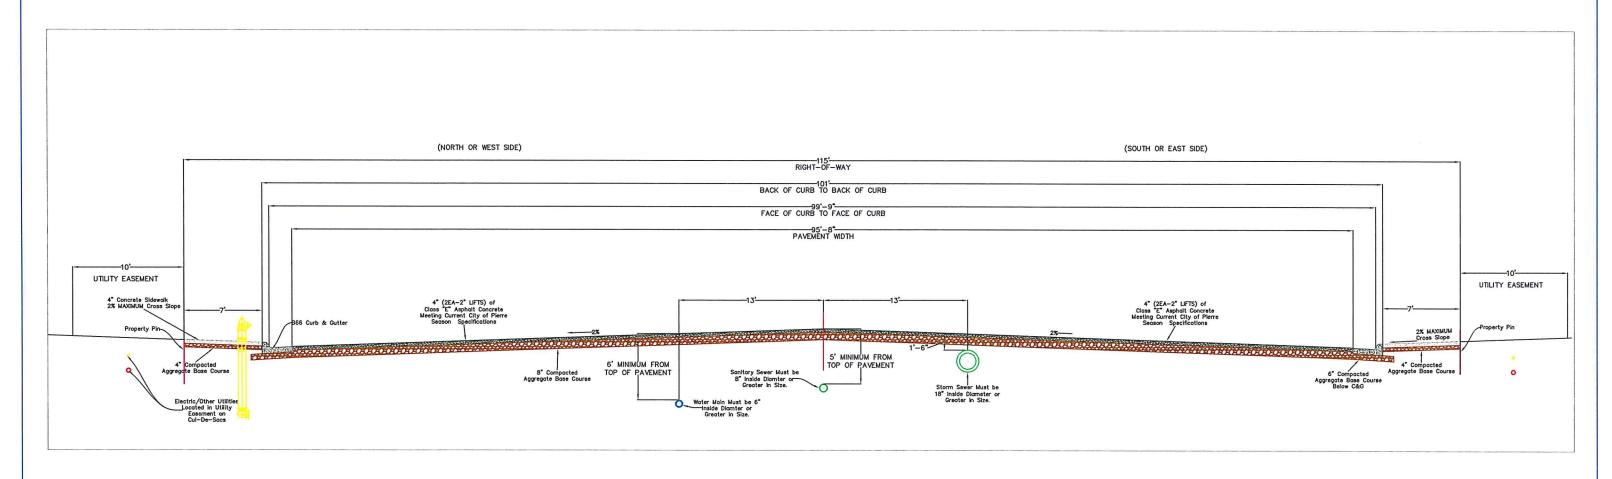

DEPTH OF COVER REQUIREMENTS	
<u>UTILITY</u>	MINIMUM BURY DEPTH
STORM SEWER**	18"
SANITARY SEWER**	60"
WATER**	72"
ELECTRICITY	30" - 40"
GAS*	18"
COMMUNICATIONS*	18"
CABLE TV*	18"

^{*} Utilities sharing trench with Electric Service must have a minimum vertical separation of 12" **10' Lateral Separation is Required from Outside of Pipe to Outside of Pipe.

City of Pierre

Engineering Department